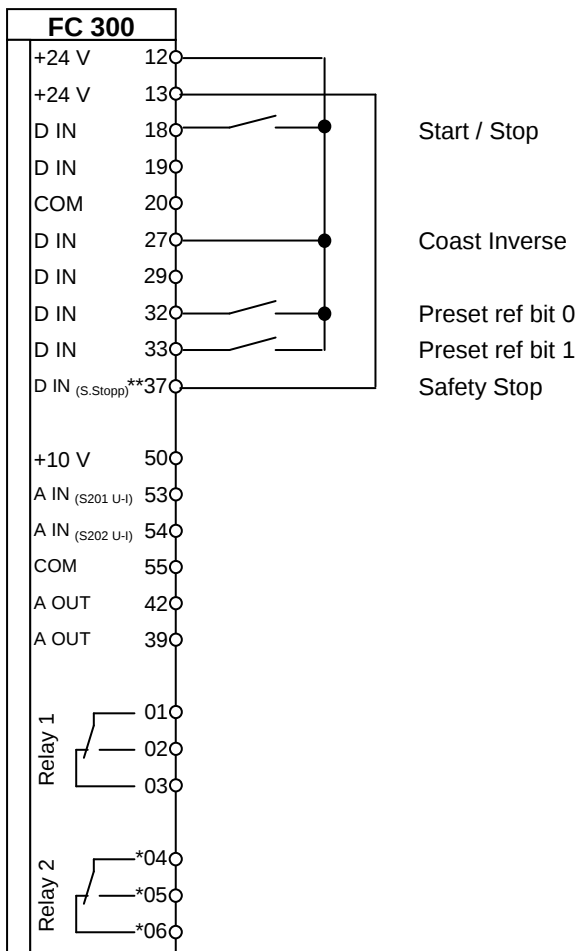


VLT® AutomationDrive

Danfoss

A fan is to be controlled between 10 to 50Hz. A 0-10V DC potentiometer is used as the speed reference.

[illegible]

Erstellt von: Schulung

All settings are based on factory settings.

It is recommended to set all the motor parameters in Par. 1-20 to 1-26 and then perform Automatic Motor Adaption (AMA) in Par. 1-29.